

Energy Audit: 2022-23

CHHAMARIA ANCHALIK COLLEGE, CHHAMARIA

According to Energy Conservation Act, 2001, Energy Audit is the verification, monitoring and analysis of the use of energy including submission of technical report containing recommendations for improving energy efficiency with cost benefit analysis and an action plan to reduce energy consumption.

Energy and electricity audit cover the average consumption of Electrical and Natural Gas energy within the campus. Electricity audit tries to give an idea about the consumption of average Electricity power within the various Academic and Administrative Blocks of the College campus. On the other hand, within the Hostel's Natural gases (LPG cylinders) are primarily used for cooking purpose. Moreover, Chhamaria Anchalik College is taking its initial initiatives to utilize renewable energy such as solar power energy to generate electricity to compensate the necessity of electrical energy within the campus. To achieve that goal, 04 Nos of Integrated Solar Street light are already been installed within the different parts of the campus each of which generates 74KWH per day. On the other hand, to minimize the consumption of electrical energy highly efficient and low power consumable LED light panels are installed within the various departments as well as one Girls Hotel.

On an average 430 units per month of electricity energy has been consumed by the College in the year 2021-22. In the current year 2022-23, average power consumed by the same was 764 units per month. It has been observed that, there is a sharp increase of 178 % in the monthly average electrical energy consumption by the College, and it is due to increasing number of infrastructural developments within the campus. Table drawn below shows the average consumption of electrical energy per month from the financial year 2018 – 19 to 2022 – 23.

Sl. No	Financial Year	Average Energy consumption per Months (KVA)	Average Monthly Electricity Bill (Rupees)
1	2022 – 23	764	4, 814/-
2	2021 – 22	430	2, 709/-
3	2020 – 21	460	2, 895/-
4	2019 – 20	672	4, 240/-
5	2018 – 19	398	2, 507/-

Figure 1 given below shows the comparison of monthly average power consumption within the College campus.

Monthly Average Electricity Power Consumption (KVA) against Financial Year

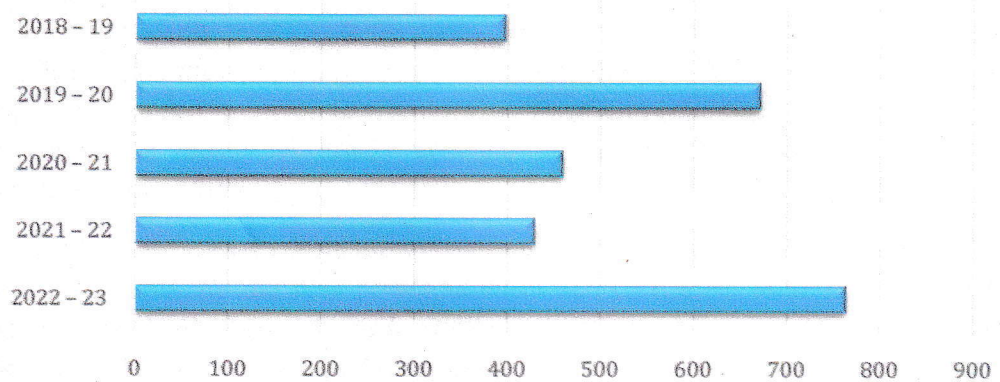


Figure 1: Average monthly consumption of electric power within the campus since 2018-18 to 2022-23

Monthly Average Expenditure on Electricity Power Consumption (KVA) against Financial Year

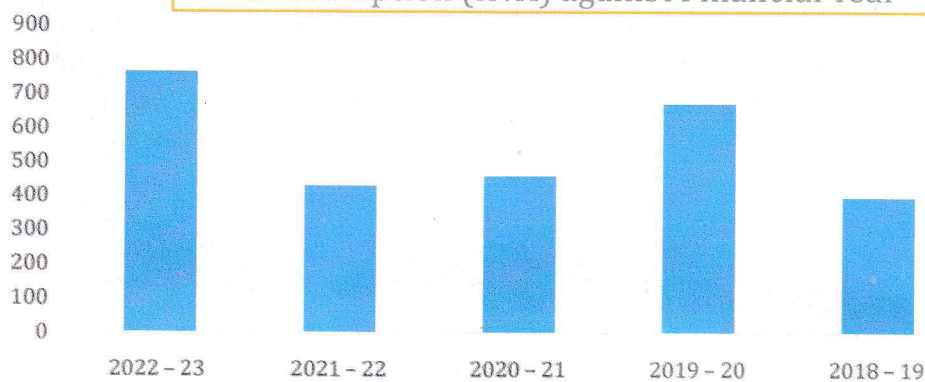


Figure 2: Monthly Average Expenditure on Electricity power consumption

Average monthly Solar Power Generated within the College Campus




Figure 3: Monthly Solar power generated (Red) and Electric Power Consumed (Pink) within


It has been observed from Figure 2, that there is an equilibrium demand in the electricity power requirement within the College campus. To compensate the rising power requirement 04 Nos of integrated solar street light are installed within the College campus. Annually, Chhamaria Anchalik College has generated **296 KWH** of electricity energy through integrated solar panels. Figure3, gives the power generated from the solar power panels installed within the College campus. In the financial year 2023-24 and 2024-25, the College authority planned to install 10 KVA OnGrid Roof Top solar panel within the College campus to minimize regular electricity consumption and to keep pace with on-going sustainable development goal.

To minimize the power consumption within the campus, Chhamaria Anchalik College is in a process of replacing old high-power Halogen and CFL blubs with low power LED Bulbs. At present Chhamaria Anchalik College have around 222 numbers of LED bulbs compared to 25 numbers of CFL bulbs and 2 numbers of high-power Halogen Bulbs in various academic and administrative blocks. Moreover, Chhamaria Anchalik College has presently 04 numbers of AC (Air Conditioner, 5 Star rated), 01 numbers of DG Sets (30 KVA) and around 126 numbers of Fans installed in different academic and administrative blocks. On the other hand, on an average 10 numbers of natural gas (LPG cylinders) per month has been consumed in the hostel, and College canteen

Recommendations:

- Installation of Solar Panels should outmost priority
- Old cables should be immediately be replaced to minimize power loss
- Bulbs other than energy efficient LED must not be used
- All AC's should be upgraded to 5* (Five Star) operating at low voltage

Prepared by


Dr Alok Das,
Associate Professor
Department of Mathematics
J.N. College, Boko


Dr Nuruddin Ahmed
Associate Professor
Department Chemistry
J. N. College, Boko

Supported by IQAC, Jawaharlal Nehru College, Boko

Signature of the College Authority


(Prankrishna Dev Nath)
Principal
Chhamaria Anchalik College, Boko
Principal
Chhamaria Anchalik College